
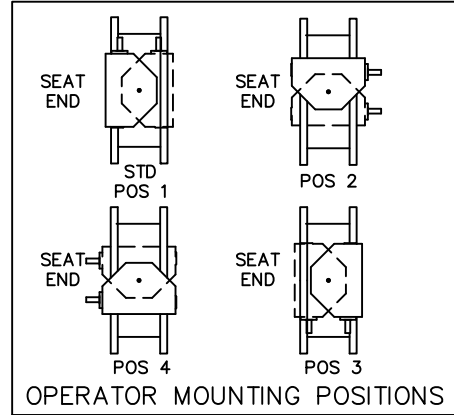


ACTUATOR SIZE	J	L	M	N	P	Q	R	NUMBER OF TURNS
MDT-3S	5-5/8	2-7/16	3-1/4	3-5/32	5-5/8	5-3/8	10-3/8	30
MDT-4S	6-3/8	2-27/32	3-3/8	4	7-5/16	6-3/4	11-5/16	40
MDT-5	7-9/16	3-15/32	4-1/2	5-1/2	8-3/4	10	17	44
MDT-5S	8-5/16	3-15/16	5-1/2	7	10-1/2	15-15/16	19-7/8	136
MDT-6S	10-3/16	5-1/16	7	8-1/4	12-5/8	14-3/16	26-1/2	215

VALVE SIZE	150 PSI						
	A	B	C	D	E	F	G
24	18-5/8	18-3/8	32	8	1-7/8	20-1-1/4	29-1/2
30	21-1/2	24-1/8	38-3/4	12	2-1/8	28-1-1/4	36
36	25-7/16	28-1/4	46	12	2-7/16	32-1-1/2	42-3/4
42	29-7/8	32-11/16	53	12	2-5/8	36-1-1/2	49-1/2
48	34-1/16	36-7/8	59-1/2	15	2-3/4	44-1-1/2	56
54	37-1/2	40-11/16	66-1/4	15	3	44-1-3/4	62-3/4
60	41-3/4	45-3/16	73	15	3-1/8	52-1-3/4	69-1/4
66	46-1/16	49-1/2	80	18	3-3/8	52-1-3/4	76
72	50	53-1/8	86-1/2	18	3-1/2	60-1-3/4	82-1/2

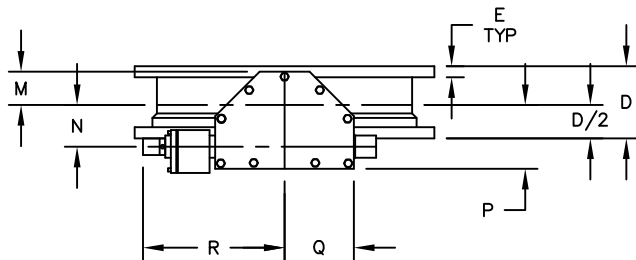


A. CHECK WITH FACTORY WHEN SELECTING ALTERNATE MIRROR ACTUATOR STYLES.

BURIED SERVICE NUT
ACTUATOR POSITION 1

F = NO. & SIZE OF BOLTS
125# STANDARD LAYOUT
STRADDLE CENTERLINE
INCLUDES TAPPED HOLES
EACH FLANGE

TAPPED HOLES VALVE SIZE	UNC2B X E DEEP NO. TAPPED HOLES (EACH FLANGE)
30"-72"	4-TOP; 4-BOTTOM
24"	2-TOP; 2-BOTTOM

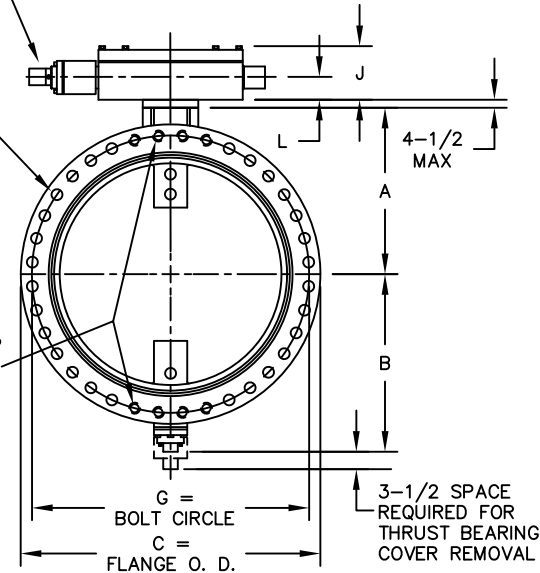

TOLERANCES	
FLANGE THICKNESS "E":	+1/4" -0
LAYING LENGTH "D":	
24" THRU 72"	+1/8"
BOLT CIRCLE "G":	+1/16"
FLANGE O.D. "C":	
24" THRU 48"	+3/16"
54" THRU 72"	+1/4"

NOTES:

- ALL DIMENSIONS SHOWN IN INCHES.
- "D" DIMENSION ±1/8".
- FOR BOLTS SMALLER THAN Ø1-3/4, BOLT HOLES WILL BE 1/8" LARGER THAN DIAMETER OF BOLT. FOR BOLTS Ø1-3/4 OR LARGER, BOLT HOLES WILL BE 1/4" LARGER THAN DIAMETER OF BOLT.
- DIMENSIONS AND DRILLING OF END FLANGES CONFORM TO THE AMERICAN CAST IRON FLANGE STANDARDS, CLASS 125 (B16.1).
- VALVES MANUFACTURED & TESTED IN ACCORDANCE WITH AWWA SPECIFICATION C-504 LATEST REVISION, CLASS 150B.
- RECOMMENDATION FOR MATING FLANGES: WHERE INSULATING BUSHINGS ARE USED, IT IS NECESSARY THAT BOLT HOLES BE DRILLED OVERSIZE BY AN AMOUNT EQUAL TO TWO TIMES THE INSULATING SLEEVE THICKNESS TO MAINTAIN THE SAME MINIMUM CLEARANCE FOR BOLTS.
- CAUTION: IT IS RECOMMENDED THAT VALVES BE INSTALLED INTO PIPING SYSTEM IN ACCORDANCE WITH AWWA M-11 TO PREVENT ANY UNDUE PIPING STRESS, DEFLECTION OR BENDING THAT MAY EFFECT THE PERFORMANCE OF THE VALVE.

REV	DATE	DESCRIPTION	DWN	APP
5	4/29/23	ADDED POS CHART	RTF	RF
4	4/28/11	28-1/4 WAS 28	JLM	CEM
3	2/3/11	2-7/16 WAS 2-3/8 ADDED TOLERANCE BLOCK	JLM	RCB
2	3/11/10	REMOVED 25 & 75 LB.	MZ	CEM
1	9/7/05	REMOVED POS IND ARROW	CEG	ES

PRATT
a MUELLER brand

GENERAL ARRANGEMENT DRAWING
TRITON XR70 FLANGED
BUTTERFLY VALVE WITH
MDT BURIED SERVICE NUT

SCALE NONE DATE 12/7/04
DRAWN BY BZ CHECKED BY ES
APPROVED GA=BORDER
DRWG. NO. GA-11304 REV 5 A/C