



VALVE SIZE	A	B	C	D	E	F	G	EH	EJ	EL	EN	EP	ER
4	9-7/8	12-1/4	10	13	1-1/4	8 x 3/4	7-7/8	14-1/4	8-1/8	2-5/16	7/8	2	2-15/16
6	10-1/2	13-1/4	12-1/2	16	1-7/16	12 x 3/4	10-5/8	16-1/2	9	2-5/16	1-1/8	2-3/8	2-15/16
8	11-1/8	13-15/16	15	18	1-5/8	12 x 7/8	13	19	10-1/8	2-3/4	1-1/2	2-3/4	3-13/16
10	12-7/8	16-1/8	17-1/2	20-1/8	1-7/8	16 x 1	15-1/4	22	11-7/8	3-3/8	1-11/16	3-1/8	4-1/8
12	15	18-1/2	20-1/2	24	2	16 x 1-1/8	17-3/4	25-5/8	13-1/2	4-1/16	1-7/8	3-3/16	3-7/8
14	17-3/8	20-5/8	23	27-3/4	2-1/8	20 x 1-1/8	20-1/4	29-3/4	15-1/2	4-1/2	2-1/16	3-1/4	4-1/2
16	20-1/16	23-1/4	25-1/2	28-1/8	2-1/4	20 x 1-1/4	22-1/2	33	17-1/8	4-3/4	2-1/4	3-1/4	5
18	21-9/16	24-7/8	28	31	2-3/8	24 x 1-1/4	24-3/4	36-5/8	18-3/4	4-7/8	2-3/4	3-13/16	5-9/16
20	23-5/8	27-3/4	30-1/2	34	2-1/2	24 x 1-1/4	27	39-7/8	20-1/2	4-5/8	2-3/8	5-1/4	6-1/4
24	28	31-1/8	36	42-3/4	2-3/4	24 x 1-1/2	32	46	23-7/8	5	2-3/4	5-15/16	7-3/4
30	34-5/8	38-5/16	43	50-1/4	3	28 x 1-3/4	39-1/4	57-1/4	29-1/2	5-15/16	3-5/16	6-11/16	10-7/16
36	40-3/4	44-5/8	50	54	3-3/8	32 x 2	46	67-1/4	34-1/2	6-7/16	3-7/8	7-5/8	8-3/4

ACTUATOR SIZE	J	L	M	N	P	Q	S	V
WG12FB	3-9/16	2	8-1/4	2-5/8	8-5/16	2-9/16	12-1/4	14
WG14FB	3-3/4	2-1/16	10-3/16	3-1/2	10-1/32	3-1/4	14-3/16	18
WG15FB	4-3/16	2	17-15/16	4-7/8	11-13/16	4-3/8	16	18
WG20	5-1/8	2-5/16	8-5/16	3-1/2	6	5-1/4	16-5/8	18
WG30	6-7/16	3-5/16	10-1/8	4-1/4	7-5/16	6-5/16	18	18
WG40	8-7/8	3-3/4	13-7/16	2-3/4	9	8-3/8	22	24
WG50	10-11/16	4-17/32	17-3/64	4-29/32	10-5/8	10-5/8	24-7/32	24

REFER TO VENDOR DRAWING FOR CERTIFIED ACTUATOR DIMENSIONS

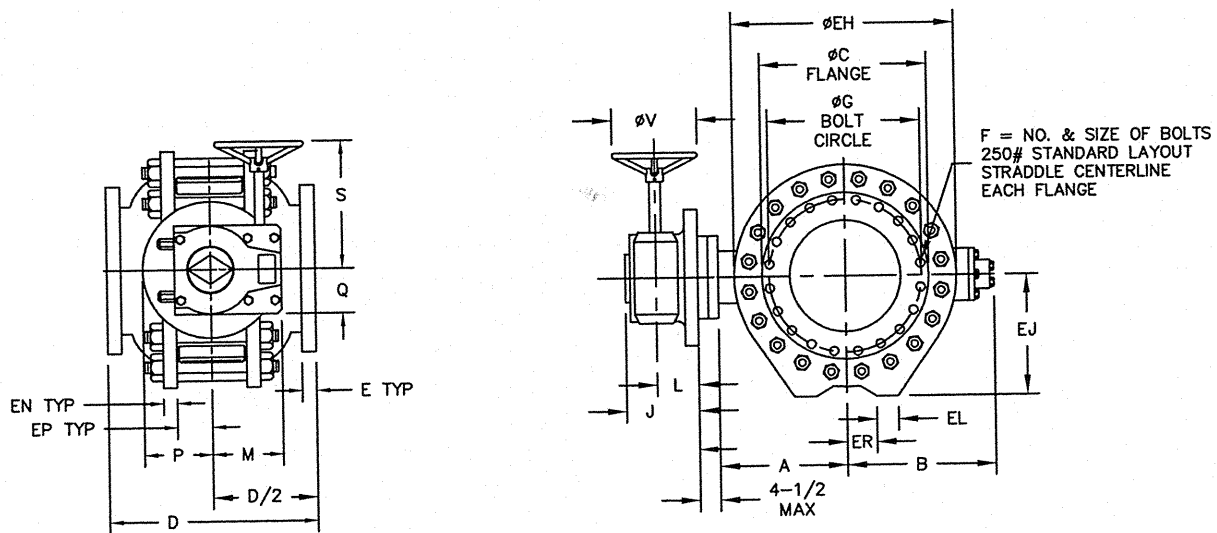

ACTUATOR POSITION A3



NOTES:

- ALL DIMENSIONS SHOWN IN INCHES.
- "D" DIMENSION $\pm 1/8"$.
- FOR BOLTS SMALLER THAN $\phi 1-3/4$, BOLT HOLES WILL BE $1/8"$ LARGER THAN DIAMETER OF BOLT. FOR BOLTS $\phi 1-3/4$ OR LARGER, BOLT HOLES WILL BE $1/4"$ LARGER THAN DIAMETER OF BOLT.
- DIMENSIONS AND DRILLING OF END FLANGES CONFORM TO THE AMERICAN CAST IRON FLANGE STANDARDS, CLASS 250(B16.1).
- VALVES MANUFACTURED & TESTED IN ACCORDANCE WITH AWWA SPECIFICATION C-507 LATEST REVISION, CLASS 300.
- RECOMMENDATION FOR MATING FLANGES: WHERE INSULATING BUSHINGS ARE USED, IT IS NECESSARY THAT BOLT HOLES BE DRILLED OVERSIZE BY AN AMOUNT EQUAL TO TWO TIMES THE INSULATING SLEEVE THICKNESS TO MAINTAIN THE SAME MINIMUM CLEARANCE FOR BOLTS.
- VALVE ROTOR SHOWN IN OPEN POSITION.
- CAUTION: IT IS RECOMMENDED THAT VALVES BE INSTALLED INTO THE PIPING SYSTEM IN ACCORDANCE WITH AWWA M-11 IN ORDER TO PREVENT ANY UNDUE PIPING STRESS, DEFLECTION OR BENDING THAT MAY EFFECT THE PERFORMANCE OF THE VALVE.

REV	DATE	BY	DESCRIPTION	APP
7/12/13	JUR		REVISED TABLE	RLB
PRATT HENRY PRATT COMPANY AURORA, ILL.				
300# RUBBER SEATED BALL VALVE PRATT WORMGEAR W/HW				
SCALE		NONE		DATE
				10/26/12
DRAWN BY		AMJ		CHECKED BY
				CEM
APPROVED		GA=BORDER		
DRWG. NO.	GA-12267	REV	1	AC