

COMPACT CHECK VALVES

Engineering Creative Solutions for Fluid Systems Since 1901







TABLE OF CONTENTS

CDDIA	וכוח	VDED	CHECK	WAINEC
- 3PKIII	IUI LU	AUED	LITELIA	VALVES

Standard Features
DOUBLE DISC CHECK VALVE Scope of the Line
Technical Specifications
Drawing
Materials of Construction
GLOBE STYLE CHECK VALVE Scope of the Line
Technical Specifications
Drawing
Materials of Construction
COMPACT WAFER-SILENT CHECK VALVE Scope of the Line
Technical Specifications
Drawing
Materials of Construction
PRESSURE DROP CHARTS Double Disc Check Valve
Globe Style Check Valve
Compact Wafer-Silent Check Valve

SCOPE OF THE LINE

Double Disc Check Valve - Series 740G

SPRING LOADED CHECK VALVES

STANDARD FEATURES

- Spring Loaded for Non-Slam Closure
- Heavy Duty Ductile Iron Body
- Automatic Operation
- Designed for ANSI Class 125 Flange Bolting
- Economical Purchase Price
- Suitable for Horizontal or Vertical (up) Piping
- Available in Sizes 2" thru 24"
- Compact Design




BODY	Ductile Iron-Wafer Pattern
DISC	304 Stainless Steel
SPRING	316 Stainless Steel
SEAT	EPDM (Elastomer)
RATING	250 psi
COATING	Fusion Bonded Epoxy (interior and exterior)
AVAILABILITY	2" through 24"

DOUBLE DISC CHECK VALVE

TECHNICAL SPECIFICATIONS

Check valve shall be of the double disc, wafer style with torsion spring induced closure. Valve shall be Wafer style for bolting between ANSI Class 125 flanges and shall be rated for 250 PSI service. Valves have a Ductile Iron body (ASTM A-536 65-45-12) to fit inside 125# ANSI bolt circles, a two piece Stainless Steel disc (ASTM type 304), type 304 Stainless Steel dual shafts, ASTM A313, type 316 Stainless Steel torsion spring and have an integrally molded elastomer seat vulcanized to the body. Valve for horizontal flow shall be installed with the shafts in vertical position. Double disc check valve shall be Pratt® Series 740G as manufactured by us.

DOUBLE DISC CHECK VALVE – SERIES 740G

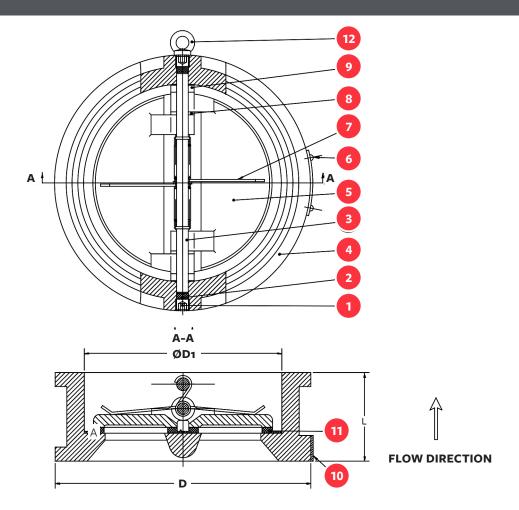

2"-24"

SIZE	L	ØD1	ØD	WEIGHT (LBS)
2″	2.13	2.56	4.10	7.49
2.5″	2.36	3.15	4.84	9.39
3″	2.64	3.70	5.31	12.52
4″	2.64	4.61	6.85	13.62
6"	3.74	6.69	8.70	24.78
8″	5	8.58	10.98	39.13
10"	5.51	10.43	13.35	62.83
12"	7.13	12.20	16.10	96.29
14"	7.24	14.76	17.64	130.07
16"	7.52	16.38	20.16	177.47
18"	8.00	18.43	21.54	244.71
20″	8.62	20.24	23.78	260.14
24"	8.74	24.33	28.11	374.78

ITEM	DESCRIPTION	QTY	MATERIAL
1	Plug	4	ASTM 1035
2	Seal	4	EPDM
3	Shaft	2	304 Stainless Steel
4	Body	1	Ductile Iron ASTM A-536 (65-45-12)
5	Disc	2	304 Stainless Steel
6	Screw	2	Aluminum
7	Spring	2	316 Stainless Steel
8	Washer 1	4	304 Stainless Steel
9	Washer 2	2	304 Stainless Steel
10	Name Plate	1	304 Stainless Steel
11	Seat	1	EPDM
12*	Lifting Ring	1	ASTM 1035

NOTE: * Only for 8" and larger

SCOPE OF THE LINE

Globe Style Check Valve – Series 821G




BODY	Ductile Iron ASTM A-536 Gr 65-45-12
DISC	304 Stainless Steel
SEAT	304 Stainless Steel / EPDM
SPRING	316 Stainless Steel (2" - 16") 304 Stainless Steel (18" - 24")
RATING	250 psi
FLANGES	ASME B16.1 CL.125
COATING	Fusion Bonded Epoxy (interior and exterior)
AVAILABILITY	2" through 24"

GLOBE STYLE CHECK VALVE

TECHNICAL SPECIFICATIONS

Check valve shall be of the silent operating type and the same size as the entering pipe. Globe style shall be rated for 250PSI service, have a Ductile Iron body (ASTM A-536 65-45-12), 125# ANSI Flat Face Flanges, ASTM A313 Type 304 Stainless Steel helical or conical spring, a Stainless Steel (ASTM type 304) seat and dual guided disc (top and bottom), 304 Stainless Steel guide bushing and type 304 Stainless Steel guide pins. Check valve to have a minimum open area in the body of 110% of the area of the entering or corresponding pipe. Valve is to operate silently in either vertical or horizontal positions, flow up or down. Globe style check valve shall be Pratt[®] Series 821G as manufactured by us.

GLOBE STYLE CHECK VALVE – SERIES 821G

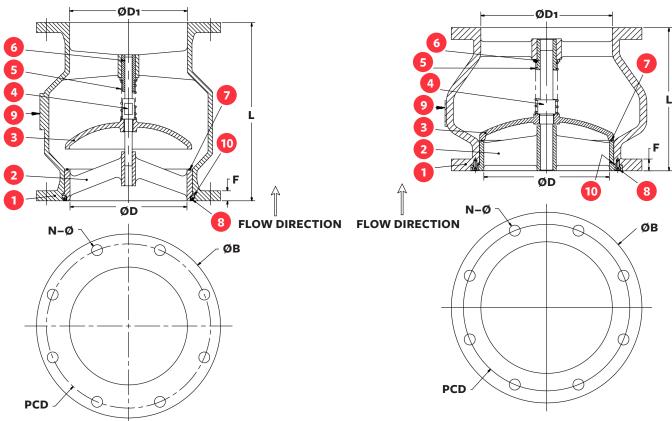

2	' _	1	2	"

SIZE	L	ØD	ØD1	F	ØB	PCD	N-Ø	WEIGHT (LBS)
2″	5.24	2.20	2.36	0.63	6.00	4.75	4-0.75	16.50
2.5"	5.50	2.87	2.95	0.69	7.00	5.50	4-0.75	20.00
3″	6.00	3.35	3.54	0.75	7.52	6.00	4-0.75	26.50
4"	7.25	4.17	4.33	0.75	9.00	7.50	8-0.75	35.50
6″	9.75	6.06	6.30	0.75	11.00	9.50	8-0.875	64.00
8"	12.50	8.19	8.11	0.79	13.50	11.75	8-0.875	128.00
10"	15.50	10.16	10.23	0.87	16.00	14.25	12-1	174.50
12"	14.25	12.13	12.2	0.98	19.00	17.00	12-1	249.50

14" - 24"

SIZE	L	ØD	ØD1	F	ØB	PCD	N-Ø	WEIGHT (LBS)
14"	15.75	13.70	13.97	1.38	21.00	18.75	12-1.12	415
16"	17.64	15.47	16.23	1.46	23.50	21.25	16-1.12	500
18"	18.75	17.00	17.56	1.57	25.00	22.75	16-1.25	631
20″	20.63	19.29	19.84	1.65	27.50	25.00	20-1.25	741
24"	24.00	22.99	23.82	1.93	32.00	29.50	20-1.38	1,209

ITEM	DESCRIPTION	QTY	MATERIAL
1	Body	1	Ductile Iron ASTM A-536 (65-45-12)
2	Seat	1	304 Stainless Steel
3	Disc	1	304 Stainless Steel
4	Stem	1	304 Stainless Steel
5	2″-16″ Spring		304 Stainless Steel
	18"-24" Spring	1	304 Stainless Steel
6	Guide Bushing	1	Bronze ASTM B584
7	Seal	1	EPDM
8	SHCS	2	304 Stainless Steel
9	Name Plate	1	304 Stainless Steel
10	Steel Ball (2"-12")	2	304 Stainless Steel
	Seat O-Ring (14"-24")	1	EPDM

VALVE	MAX.		ANDARD RING ET DIMENSIONS	
SIZE (IN)	ALLOWABLE FLANGE ID	GASKET I.D. (IN)	OD FOR 125 LB GLOBE TYPE (IN)	
2	2.76	2.56	4.09	
2.5	2.76	2.87	4.84	
3	3.35	3.50	5.35	
4	4.72	4.53	6.46	
5	5.51	5.59	7.64	
6	6.50	6.42	8.66	
8	8.27	8.46	10.67	
10	10.24	10.16	13.03	
12	12.40	12.20	14.84	
14	14.37	13.98	17.32	
16	16.34	16.34	19.29	
18	17.72	17.72	21.26	
20	19.88	19.88	23.43	
24	24.25	24.02	28.15	
* Gasket supplied by others				

^{*} Gasket supplied by others

- 1. Flat flanges and ring gaskets (rubber or compressed fiber) are required.
 2. The mating companion flange I.D. must overlap the valve seat. This is required to provide proper seat retention.
- 3. The flange gasket must be properly centered and of the size indicated. This is required to achieve a seal between the seat O.D. and the body I.D. interface area.

SCOPE OF THE LINE

Compact Wafer-Silent Check Valve – Series 720G




BODY	Ductile Iron ASTM A-536 Gr 65-45-12
DISC	304 Stainless Steel
SPRING	316 Stainless Steel
SEAT	304 Stainless Steel / EPDM
RATING	250 psi
COATING	Fusion Bonded Epoxy (interior and exterior)
AVAILABILITY	2" through 12"

COMPACT WAFER-SILENT CHECK VALVE

TECHNICAL SPECIFICATIONS

Check valve shall be of the silent wafer type and the same size as the entering pipe. Valves shall be the compact wafer style and have a pressure and temperature rating equal to or greater than the pipeline in which they are installed. Compact wafer-silent style check valves thru 6 inches shall be rated for 250PSI service for installation between ANSI Class 125 flanges, have a Ductile Iron body (ASTM A-536 65-45-12), ASTM A313, Type 304 Stainless Steel helical or conical spring, a Stainless Steel guide bushing and type 304 Stainless Steel guide pins. Valves are to operate silently in either vertical or horizontal positions, flow up or down. Compact wafer-silent check valve shall be Pratt[®] Series 720G as manufactured by us.

COMPACT WAFER-SILENT CHECK VALVE – SERIES 720G

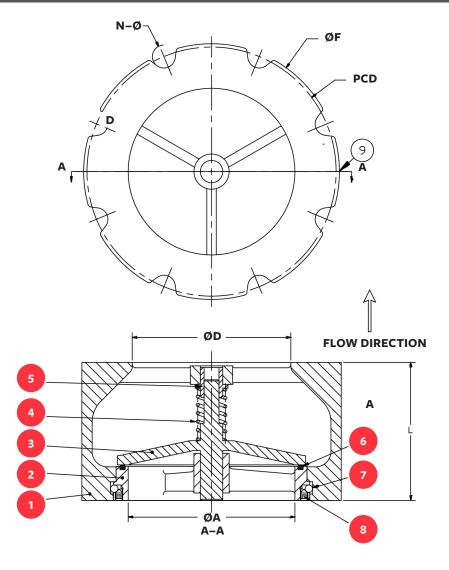

2"-12"

SIZE	L	ØD	ØF	ØA	PCD	N-Ø	WEIGHT (LBS)
2"	2.63	2.68	4.33	2.52	4.75	4-0.75	4.75
2.5″	2.87	3.07	5.35	2.83	5.50	4-0.75	8.00
3″	3.13	3.54	5.98	3.38	6.00	4-0.75	12.80
4"	4.00	4.25	7.00	4.50	7.50	8-0.75	15.50
6"	5.50	6.38	9.72	6.38	9.50	8-0.875	37.50
8″	6.50	8.50	13.37	8.37	11.75	8-0.875	80.00
10"	8.27	10.67	15.89	10.06	14.25	12-1	132.50
12"	11.26	12.24	16.34	12.12	17.00	12-1	176.50

- 1. Flat flanges and ring gaskets (rubber or compressed fiber) are required.
- are required.
 The mating companion flange I.D. must overlap the valve seat. This is required to provide proper seat retention.
 The flange gasket must be properly centered and of the size indicated. This is required to achieve a seal between the seat O.D. and the body I.D. interface area.

VALVE	MAX.	*STD RING GASKET DIMENSIONS		
SIZE	ALLOWABLE ID OF FLG	GASKET I.D.	OD FOR 125 LB WAFER TYPE	
2"	2.76	2.56	4.09	
2.5"	2.76	2.87	4.84	
3″	3.35	3.50	5.35	
4"	4.72	4.53	6.46	
5″	5.51	5.59	7.64	
6"	6.5	6.42	8.66	
8″	8.27	8.46	10.67	
10"	10.24	10.16	13.03	
12"	12.40	12.20	14.84	


^{*} Gasket supplied by others

ITEM	DESCRIPTION	QTY	MATERIAL
1	Body	1	Ductile Iron ASTM A-536 (65-45-12)
2	Seat	1	304 Stainless Steel
3	Disc	1	304 Stainless Steel
4	Spring	1	316 Stainless Steel
5	Guide Bushing	1	Bronze ASTM B584
6	Seal	1	EPDM
7	Steel Ball	1	304 Stainless Steel
8	Set Screw	2	316 Stainless Steel
9	Name Plate	1	304 Stainless Steel

PRESSURE DROP CHART

For Double Door Type Check (740G) & Globe Type Silent Check (821G) Valves

DOUBLE DISC CHECK VALVE - SERIES 740G

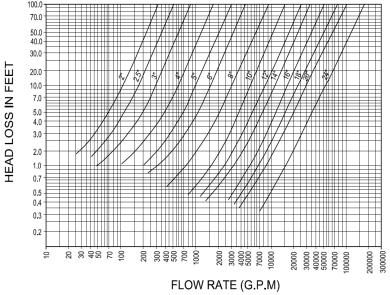


CV VALUE OF DOUBLE DISC WAFER CHECK VALVES

NOMINAL DIAMETER (INCHES)	Cv
2"	79
2.5″	120
3″	226
4"	404
5″	695
6"	1075
8″	1920
10"	3360
12"	5320
14"	6200
16"	7650
18"	9900
20"	12700
24"	19200

*Cv = The flow rate of water in U.S. gallons per minute of 60° F water, which passes through the valve with 1PSI pressure drop across the valve.

GLOBE STYLE CHECK VALVE – SERIES 821G

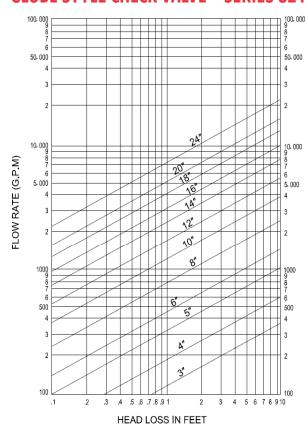

C_V VALUE OF 821G GLOBE SILENT CHECK VALVES

NOMINAL DIAMETER (INCHES)	Cv
2.5″	130
3″	160
4"	275
5″	452
6"	639
8"	1110
10"	1720
12"	2490
14"	3450
16"	4480
18"	5700
20″	7000
24"	10050

*Cv = The flow rate of water in U.S. gallons per minute of 60° F water, which passes through the valve with 1PSI pressure drop across the valve.


These charts are based on the flow of clean water at ambient temperature. Consult our Engineering Department for pressure drop information on steam, gases or viscous fluids.

Good piping practice recommends placement of check valves a distance equal to 5 to 10 pipe diameters from any turbulence producing device such as elbow, pumps etc.

PRESSURE DROP CHART

For Compact Wafer Silent Check (720G) Valve

COMPACT WAFER SILENT CHECK VALVE – SERIES 720G

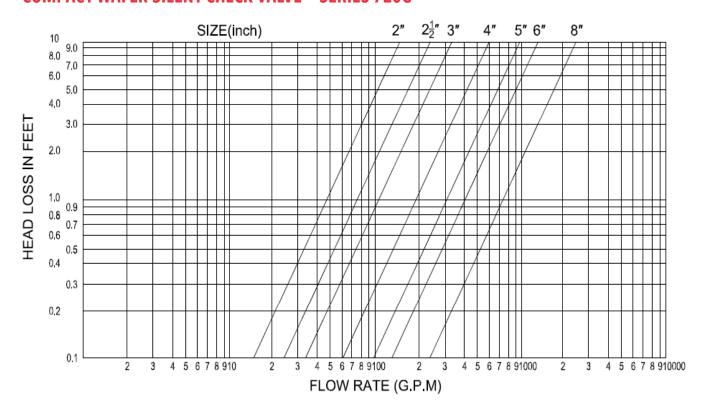

C_V VALUE OF 720G WAFER SILENT CHECK VALVE

NOMINAL DIAMETER (INCHES)	Cv
2"	67
2.5″	108
3″	155
4"	274
5″	433
6"	575
8″	1047
10"	1490
12"	2070

*Cv = The flow rate of water in U.S. gallons per minute of 60° F water, which passes through the valve with 1PSI pressure drop across the valve. This chart is based on the flow of clean water at ambient temperature. Consult our Engineering Department for pressure drop information on steam, gases or viscous fluids.

Good piping practice recommends placement of check valves a distance equal to 5 to 10 pipe diameters from any turbulence producing device such as elbow, pumps etc.

NOTES



PRATT®

Product Guide



MODEL 2FII



MONOFLANGE MKII



PLUG VALVES



TRITON* XR70



INDICATING BUTTERFLY VALVES UL & FM APPROVED



TILTING DISC CHECK VALVES



KNIFE GATE VALVES



N-STAMP NUCLEAR BUTTERFLY VALVES



CONE VALVES



RECTANGULAR



PIVA POST INDICATING VALVES ASSEMBLY UL & FM APPROVED



SLEEVE VALVES



RUBBER SEATED BALL VALVES



TRITON*250



CHECK VALVES



METAL SEATED BALL VALVE



CONTROL SYSTEMS



INDUSTRIAL VALVES



AIR VALVES

For more information about us or to view our full line of water products, please visit www.prattvalve.com or call Pratt customer service at 1.800.423.1323.

Mueller refers to one or more of Mueller Water Products, Inc., a Delaware corporation ("MWP"), and its subsidiaries. MWP and each of subsidiaries are legally separate and independent entities when providing products and services. MWP does not provide products or services to third parties. MWP and each of its subsidiaries are liable only for their own acts and omissions and not those of each other MWP brands include Mueller®, Echologics®, Hydro Gate®, Hydro-Guard®, Jones®, Mi.Net®, Milliken®, Pratt®, Singer®, and U.S. Pipe Valve & Hydrant. Please see www.muellerwp.com/about to learn more.

Copyright © 2018 Henry Pratt Company, LLC. All Rights Reserved. The trademarks, logos and service marks displayed in this document are the property of Mueller Water Products, Inc., its affiliates or other third parties. Products marked with a section symbol (§) are subject to patents or patent applications. For details, visit www.mwppat. com. These products are intended for use in potable water applications. Please contact your Mueller Sales or Customer Service Representative concerning any other application(s).

